


NOTE: #2, #4 & #7 T-STAT TERMINALS GET 0459-190 TERM. HOUSING COVERS

SYM	NOTICE	REVISIONS	DESCRIPTION	DATE	APPROVED
-	ER 13/048	NEW DRAWING RELEASE		10/29/13	JS
A	EC 15/069	CHANGED WIRE #55 TO 46" STRIP/STRIP		2/24/15	JS
B	EC 18/074	CHANGED WIRE POSITIONS IN JUNCTION BOX		2/19/18	JS/SJS
C	EC 18/376	CHANGED WIRE #27 TO 6" STRIP/STRIP		6/27/18	NEW/SJS
D	EC 20/332	MOVED WIRES ON TERMINAL BLOCK		11/5/20	JS/SJS



38 WIRES W/SINGLE HEATER
34 WIRES STD. UNIT

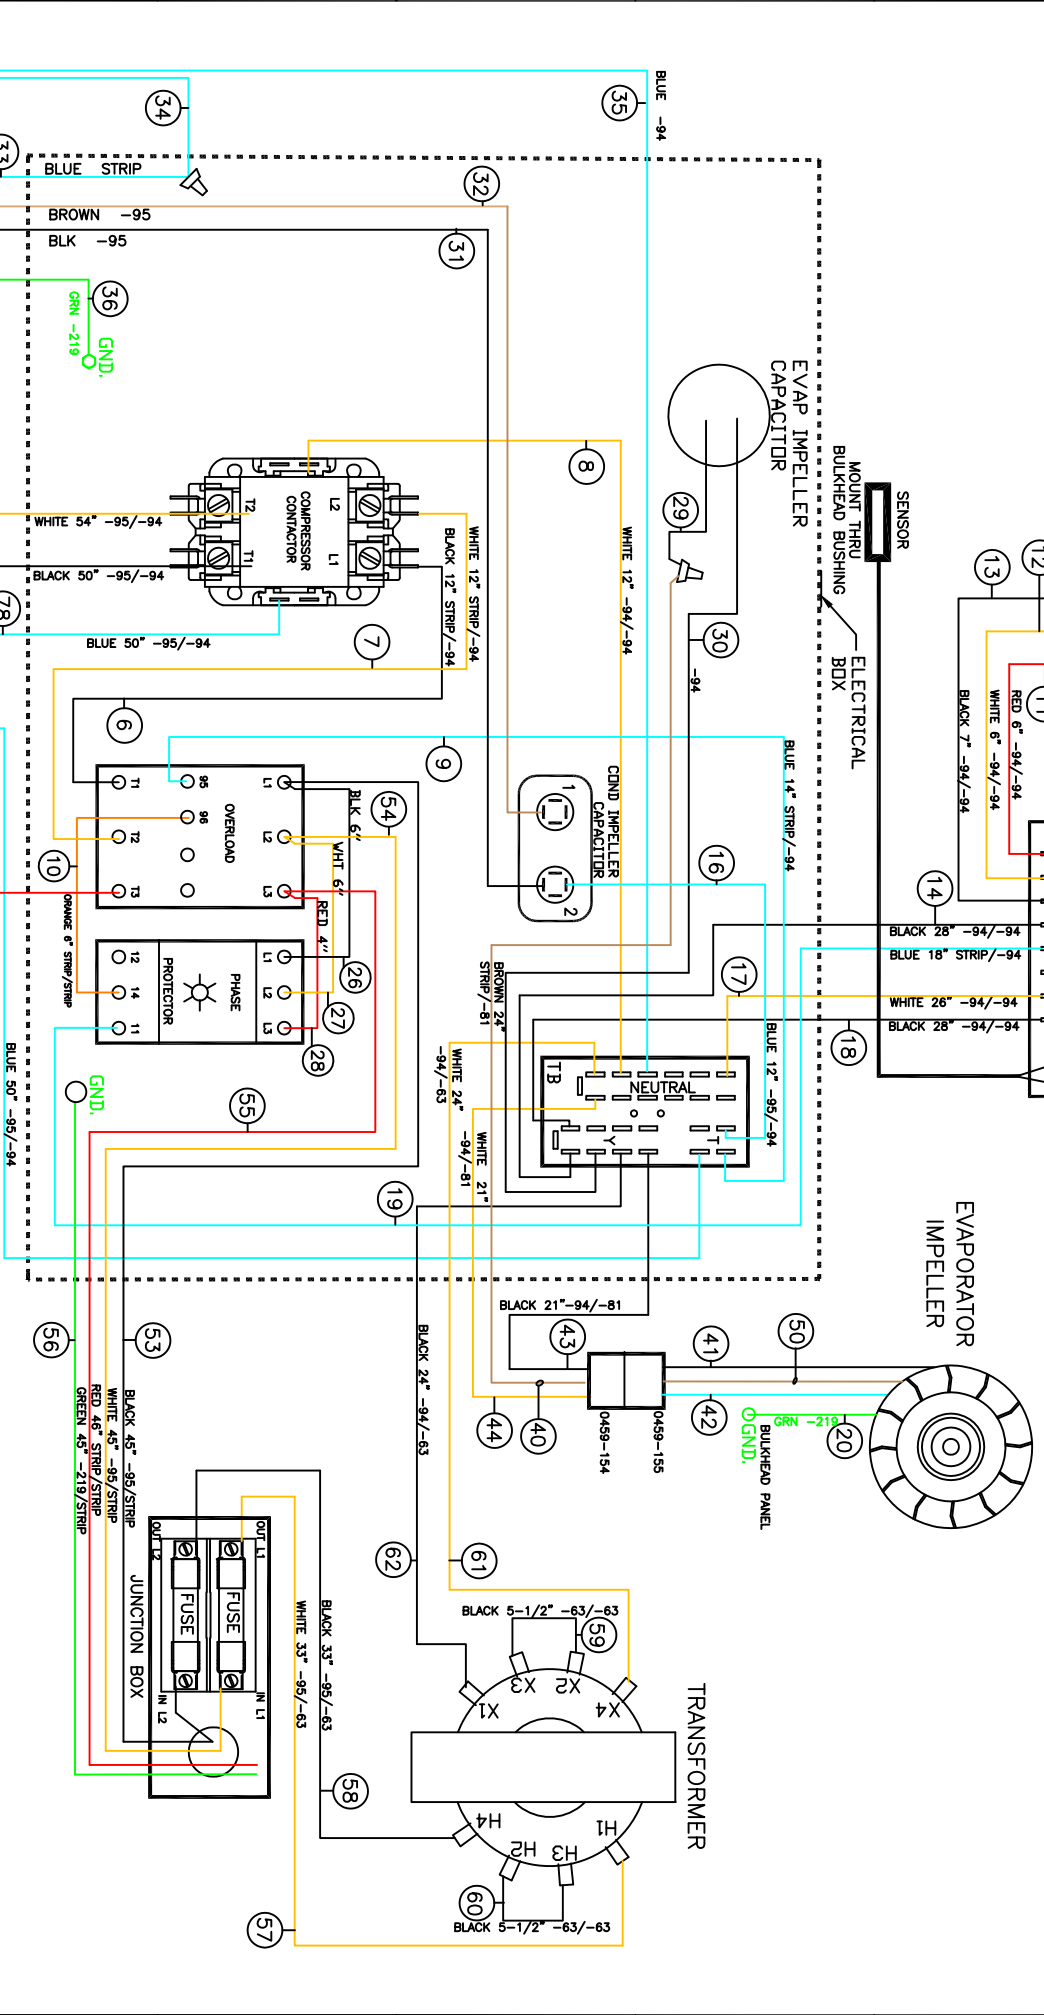

WIRING DIAGRAM

DIMENSIONS ARE IN INCHES. UNLESS OTHERWISE SPECIFIED TOLERANCES NON-ACCUMULATIVE				DATE	
TOL. ON	INCHES	MM	CHECKED	Mike Mc Grohan	11/19/13
XX	± .02	±	ENG.	J. DISLER	5/19/14
XXX	± .010	±	MFG. ENG.		
ANGULAR	± 1/2°				
MATERIAL				CODE IDENT. NO.	SIZE
UNIT				06223	C
SP				6K 460V 3ph	WD-1441
APPROVED				Joe M/Bruce K	5/27/14
SCALE				NONE	REF. D
SHEET				1	OF 1