


THIS DOCUMENT IS THE PROPERTY OF KOOLTRONIC, INC. AND CONTAINS PROPRIETARY AND CONFIDENTIAL INFORMATION WHICH MUST NOT BE DUPLICATED, USED OR DISCLOSED OTHER THAN AS EXPRESSLY AUTHORIZED BY KOOLTRONIC, INC.

NOTE: #2, #4 & #7 T-STAT TERMINALS GET 0459-190 TERM. HOUSING COVERS



20 WIRES

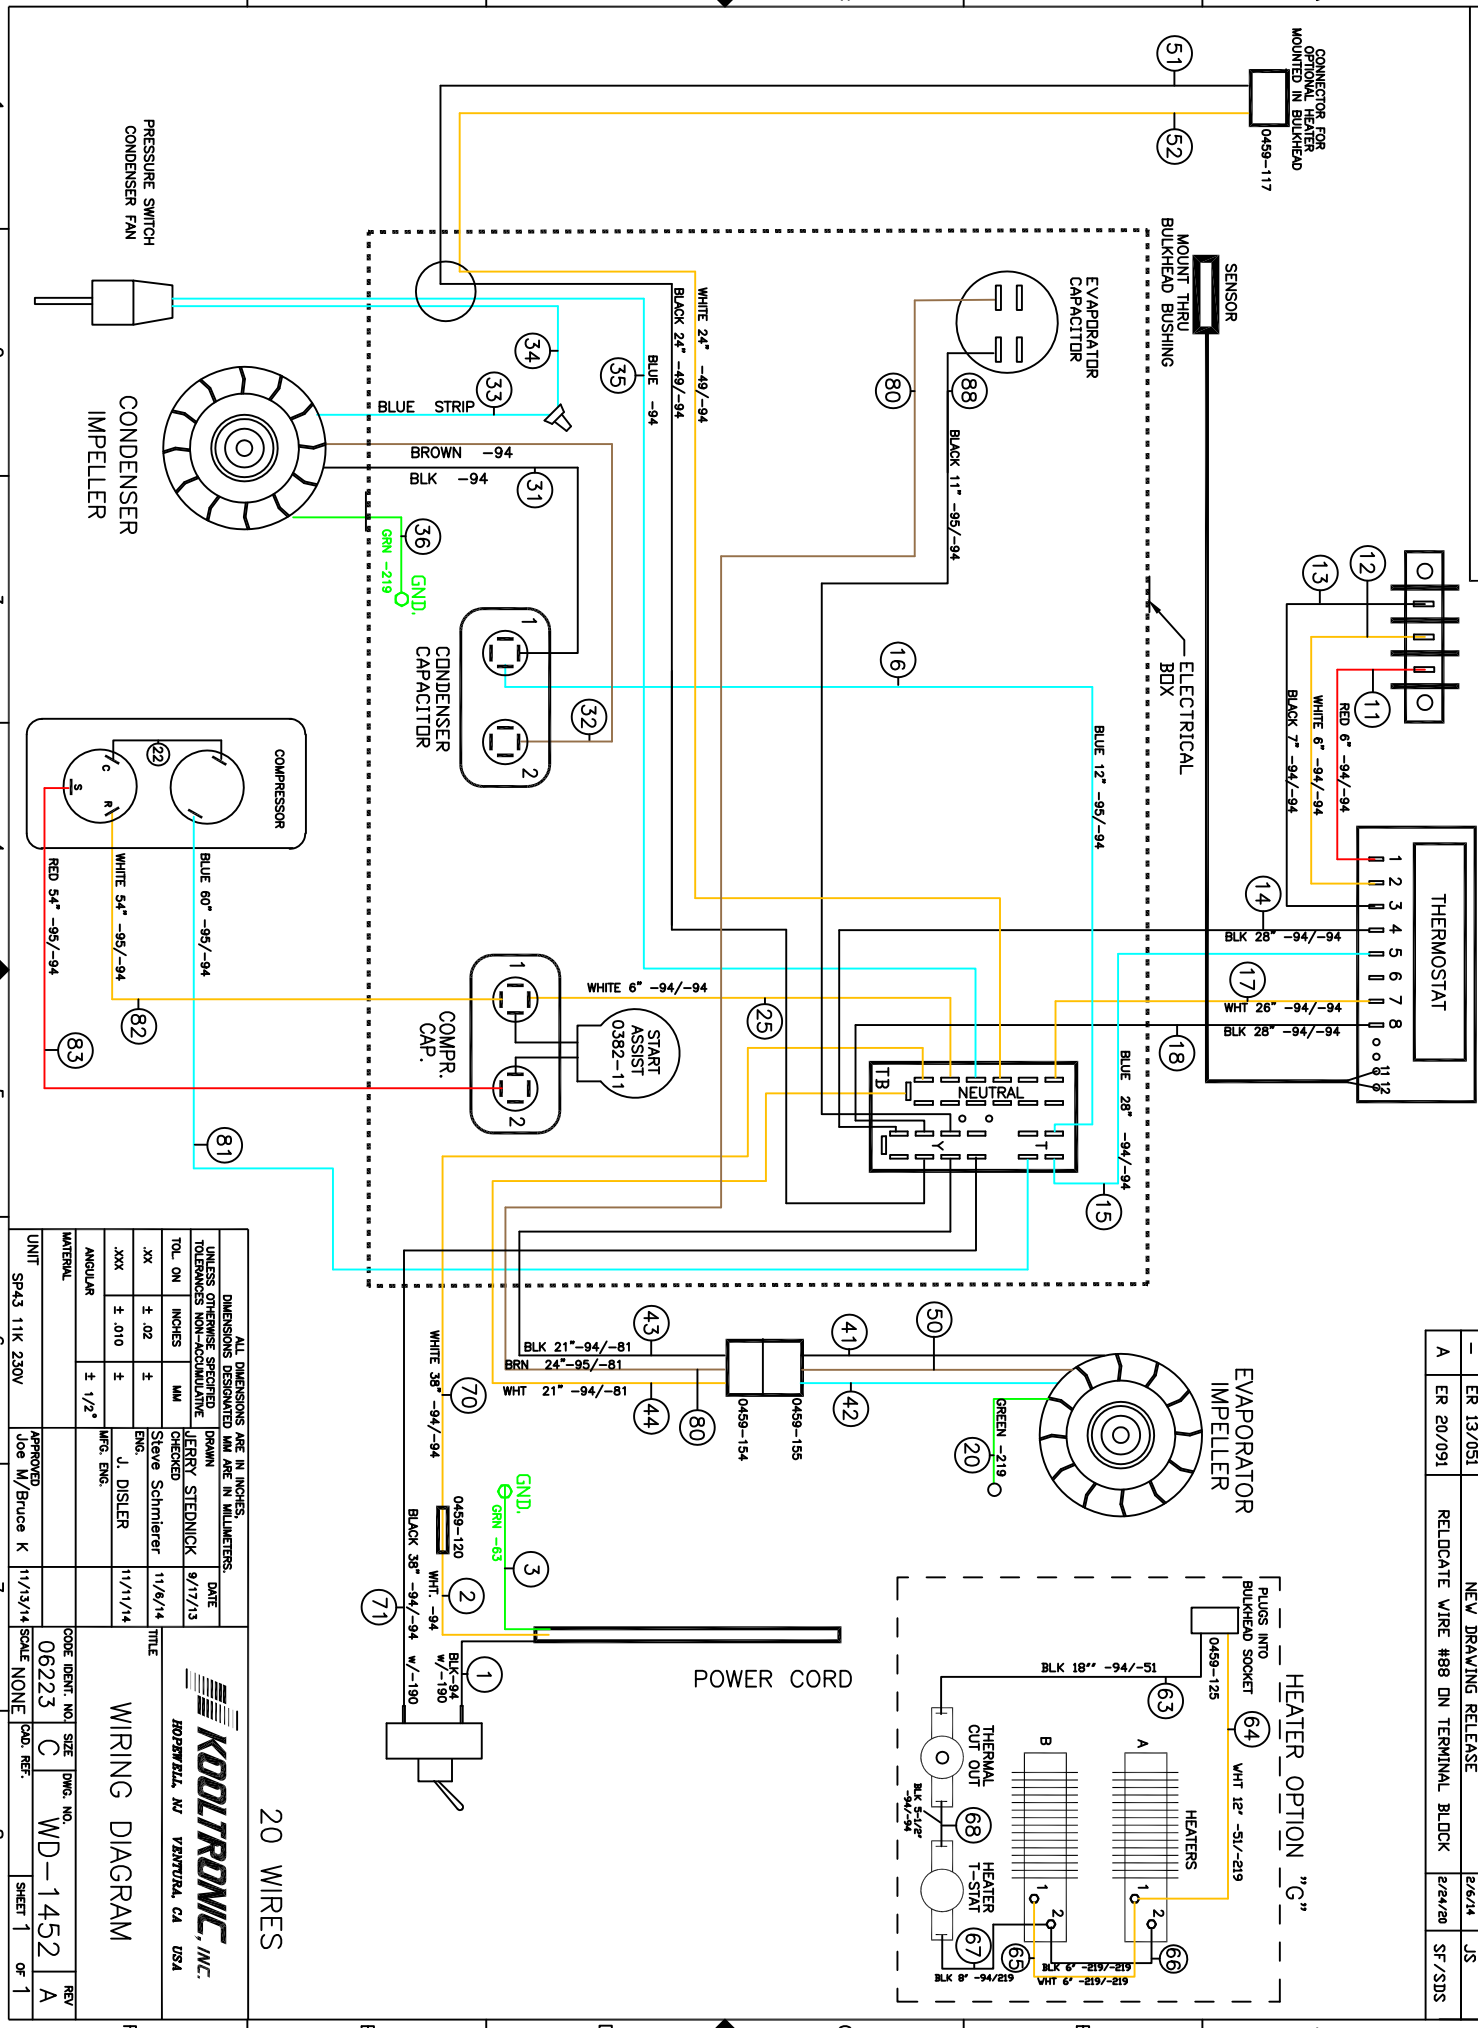

ROPERWELL, NJ VENTURA, CA USA

WIRING DIAGRAM

DIMENSIONS ARE IN INCHES, UNLESS OTHERWISE SPECIFIED		DIMENSIONS DESIGNATED MM ARE IN MILLIMETERS.	
TOL. ON INCHES	± .02	TOL. ON MM	± .13
XX	± .010	XX	± .25
ANGULAR	± 1/2°	ANGULAR	± 1/2°
MATERIAL		MATERIAL	
UNIT	SP43 11K 230V	UNIT	SP43 11K 230V
APPROVED	Joe M/Bruce K	APPROVED	Joe M/Bruce K
DATE	11/13/14	DATE	11/13/14
SCALE	NONE	SCALE	NONE
CODE IDENT. NO.	06223	CODE IDENT. NO.	06223
SIZE	C	SIZE	C
DWG. NO.	WD-1452	DWG. NO.	WD-1452
REV	A	REV	A
CAD. REF.		CAD. REF.	
SHEET	1	SHEET	1
OF	1	OF	1

REV	NOTICE	DESCRIPTION	DATE	APPROVED
-	ER 13/051	NEW DRAWING RELEASE	2/6/14	JS
A	ER 20/091	RELOCATE WIRE #88 ON TERMINAL BLOCK	2/24/20	SF/SJS