


THIS DOCUMENT IS THE PROPERTY OF KOOLTRONIC, INC. AND CONTAINS PROPRIETARY AND CONFIDENTIAL INFORMATION WHICH MUST NOT BE REPRODUCED, COPIED, DISCLOSED TO OTHERS, EXCEPT AS EXPRESSLY AUTHORIZED IN WRITING BY KOOLTRONIC, INC.

NOTE: ROUTE THE CAPILLARY THRU THE SLOT PROVIDED AT THE GROMMET END OF THE THERMOSTAT.

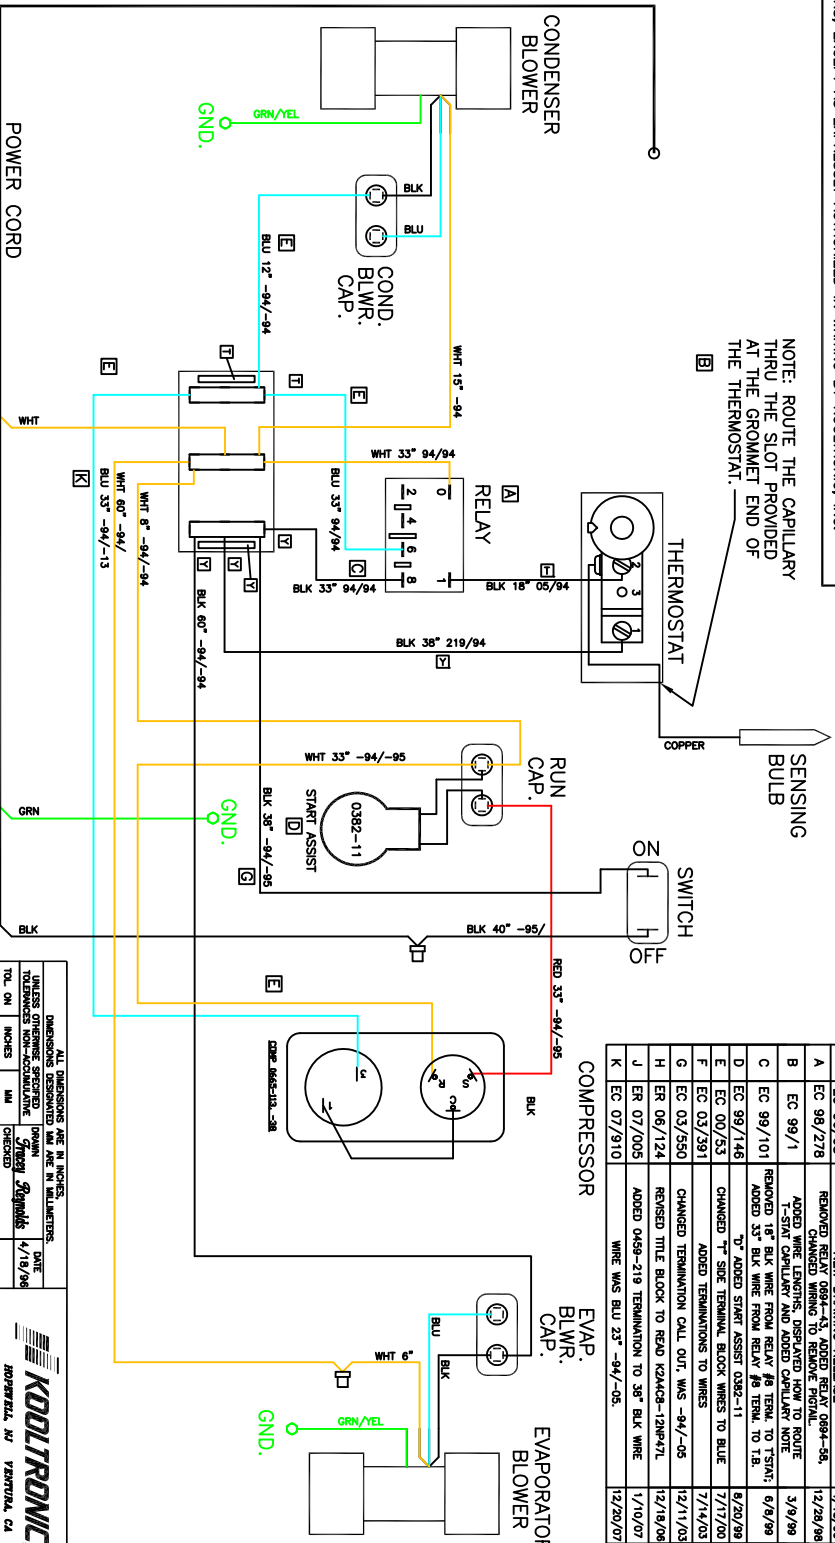

REVISIONS			DATE	APPROVED
REV	DESCRIPTION	DATE	APPROVED	
-	EC 98/28	NEW DRAWING RELEASE	4/18/98	TJR
A	EC 98/27/8	REMOVED RELAY 0382-11 ADDED RELAY 084-58, CHANGED WIRING TO REMOVE FPGM.	12/28/98	RL
B	EC 99/1	ADDED WIRE LENGTHS, DISPLAYED HOW TO ROUTE T-SIDE CAPILLARY AND ADDED CAPILLARY NOTE	3/9/99	RL
C	EC 99/101	REMOVED 18\" BLK WIRE FROM RELAY #8 TERM. TO T51A1; ADDED 33\" BLK WIRE FROM RELAY #8 TERM. TO T.B.	6/9/99	MRM
D	EC 99/146	TO ADDED START ASSIST 0382-11	8/20/99	ROD
E	EC 00/53	CHANGED T+ SIDE TERMINAL BLOCK WIRES TO BLUE	7/17/00	MRM
F	EC 03/391	ADDED TERMINATIONS TO WIRES	7/14/03	SDS
G	EC 03/550	CHANGED TERMINATION CALL OUT. WAS -94/-05	12/11/03	J.S
H	EC 06/124	REMOVED TITLE BLOCK TO READ K24AC8-12NP47L	12/18/06	ROD
J	EC 07/005	ADDED 0459-219 TERMINATION TO 38\" BLK WIRE	1/10/07	ROD
K	EC 07/910	WIRE WAS BLU 23\" -94/-05.	12/20/07	DM-

DIMENSIONS DESIGNATED MM ARE IN MILLIMETERS.			DIMENSIONS DESIGNATED INCH ARE IN INCHES.		
TOL.	CH.	INCHES	TOL.	CH.	MILLIMETERS
XX	± .02	±	XX	± .02	±
XXX	± .010	±	XXX	± .010	±
ANGULAR	± 1/2°		ANGULAR	± 1/2°	
K24AC8-12NP47L			K24AC8-12NP47L		
APPROVED BKK			APPROVED BKK		
12/18/03			12/18/03		
06223			06223		
WD-231			WD-231		
L			L		

KOOLTRONIC, INC.
200 PINE HILL, NJ 07033
YARWATER, CA 92554

WIRING DIAGRAM
AIR CONDITIONER